

DLA-PP (Polypropylene Drum Alarm)

Aug 2, 2012


1. CONNECT BATTERY

Open the cover and snap the battery inside into the battery clip. Replace cover. On units powered by AC adapter, plug in the power jack.


2. CONNECT TUBING

The JACO compression fitting will work on hard or soft tubing.

- Cut tubing squarely. (Remove burrs if hard tubing)
- Insert tubing through the nut all the way to the back.
- Turn the nut hand tight.

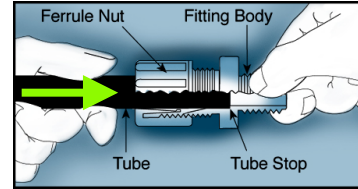

If it is necessary to replace the compression fitting, screw the new teflon-taped fitting only one turn past hand tight.



3. ADJUST DEPTH

Loosen set screws to change the depth if desired.



ADJUST DEPTH WITH SET SCREW


4. BATTERY REMINDER

Put a reminder on your PM program to replace the battery according to this chart. As a guide, a single standard lithium battery will provide 50 hours of continuous alarming and has a shelf life of 10 years.

ALARM FREQUENCY	REPLACEMENT INTERVAL
Several times daily	Yearly
Once a day	two years
Weekly	4 years
Monthly	6 years
Never	10 years

5. SERVICE

- The float is protected by a “float guard” which can be unscrewed for inspection if desired.
- The screen and check valve (if applicable) can be removed by unscrewing the retainer ring with a nickel.

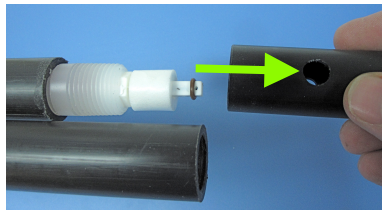

UNSCREWING FLOAT GUARD



UNSCREWING RETAINER RING